



LEADS TO TYPICAL ELECTROLYSIS CONTROL
FOUR-WIRE TEST STATION. SEE STD. DWG.
ET-3-08 OR ET-4-08

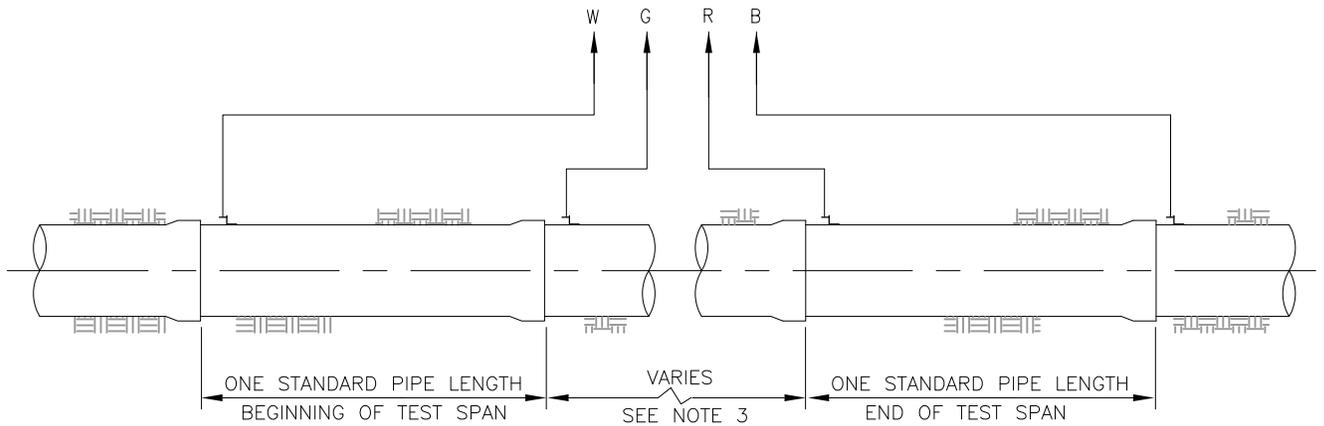

CALIBRATED ELECTROLYSIS TEST SPAN

NTS



NOTES:

1. ELECTROLYSIS TEST LEADS SHALL CONFORM TO THE FOLLOWING, UNLESS OTHERWISE SPECIFIED:

TYPE: STRANDED COPPER
 STYLE: T.H.W.N. OR U.S.E. RATED INSULATION
 MIN. SIZE: A.W.G. NO. 10
 COLOR CODE: B - BLACK
 W - WHITE
 G - GREEN
 R - RED

2. ELECTROLYSIS TEST LEADS SHALL BE ATTACHED TO THE PIPE IN ACCORDANCE WITH STANDARD DRAWING ET-1-08.
3. DISTANCE AS SHOWN ON PROJECT DRAWINGS.
4. SUFFICIENT SLACK SHALL BE LEFT IN LEADS NEAR CONNECTIONS TO PIPES TO PREVENT BREAKAGE OF CONNECTION DURING BACKFILLING.



ALAMEDA COUNTY WATER DISTRICT
43885 SOUTH GRIMMER BOULEVARD
P.O. BOX 5110
FREMONT, CA 94537-5110
(510) 668-4200

STANDARD DRAWING

ELECTROLYSIS TEST STATION STEEL PIPE CALIBRATION SPAN

APPROVED

Albert Chavez
ENGINEERING MANAGER

12/15/2008

DATE

					DESIGNED	ACWD	DATE:	DEC. 2008
					DRAWN	RMF	SCALE:	NONE
0	12-08	REPLACES STD. DWG. ET-2	RMF	LJA	CHECKED	LJA	DWG. NO.	ET-2-08
NO.	DATE	REVISION	BY	APP.	DIV. MGR.	EHS	REV.	