




TEXT SHALL BE CENTERED ON FACE OF MARKER POST. SEE NOTE 4

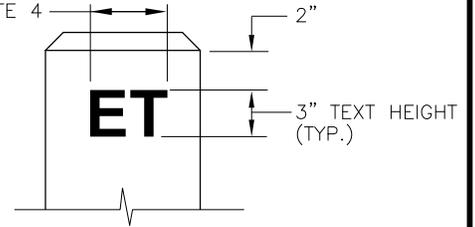

MARKINGS DETAIL (1) NTS

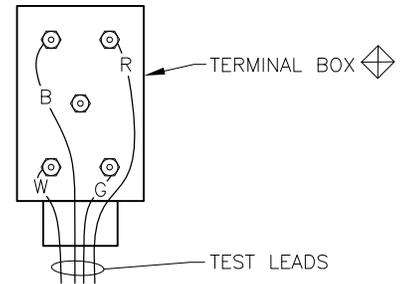

FOUR WIRE TEST STATION (4U ETS) (SYMBOL)

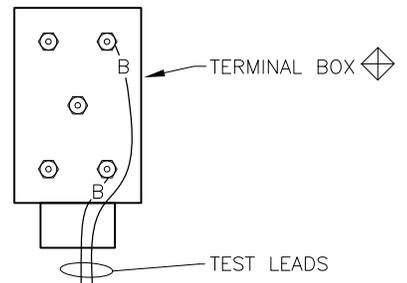

TWO WIRE TEST STATION (2U ETS) (SYMBOL)

MARKER POST INSTALLATION

NTS

NOTES:

- ELECTROLYSIS TEST LEADS SHALL CONFORM TO THE FOLLOWING, UNLESS OTHERWISE SPECIFIED:
 STYLE: STRANDED COPPER
 TYPE: T.H.W.N. OR U.S.E. RATED INSULATION
 MIN. SIZE: A.W.G. NO. 10
 COLOR CODE:
 B - BLACK
 W - WHITE
 G - GREEN
 R - RED
- ELECTROLYSIS TEST LEADS SHALL BE ATTACHED TO THE PIPE IN ACCORDANCE WITH STANDARD DRAWING ET-1-08.
- PLACEMENT OF MARKER POST:
 A. SET POSTS VERTICALLY TRUE AND FACING WATER MAIN.
 B. MARKER POSTS SHALL NOT BE SET IN TRAVELLED WAY.
 C. DO NOT SET POSTS ON PRIVATE PROPERTY WITHOUT EASEMENT.
- REFERENCE LETTERS SHALL BE INCISED OR CHISELED ON WOOD AND PAINTED RED.

APPROVED *Robert Chavez* 12/15/2008
 ENGINEERING MANAGER DATE

◇ - FURNISHED BY THE DISTRICT



ALAMEDA COUNTY WATER DISTRICT
 43885 SOUTH GRIMMER BOULEVARD
 P.O. BOX 5110
 FREMONT, CA 94537-5110
 (510) 668-4200

STANDARD DRAWING

ELECTROLYSIS TEST STATION MARKER POST INSTALLATION UNDEVELOPED AREAS

DESIGNED	ACWD	DATE:	DEC. 2008
DRAWN	RMF	SCALE:	NONE
CHECKED	LJA	DWG. NO.	ET-3-08
NO.	DATE	REVISION	
BY	APP.	DIV. MGR.	0