


ITEM	DESCRIPTION
1	2" BRASS BLIND METER FLANGE
2	3/4"x2-1/2" BRASS BOLTS WITH NUTS (2) (THREAD END TOWARD CURB)
3	CHRISTY B36 METER BOX (OR APPROVED EQUAL)
4	CHRISTY FL36GOC207 FIBRELYTE LID (OR APPROVED EQUAL)
5	2"x4"x36" REDWOOD OR PRESSURE-TREATED WOOD BOARDS (2)
6	2" ANGLE METER STOP WITH LOCK WINGS, COMPRESSION x FLANGE
7	2" POLYETHYLENE SERVICE LINE

NOTES:

1. WHERE MONOLITHIC SIDEWALK IS MORE THAN 10'-0" WIDE, ANGLE METER STOP SHALL BE 12" BEHIND BACK OF CURB, UNLESS OTHERWISE SHOWN ON THE PROJECT DRAWINGS OR APPROVED BY THE DISTRICT.
2. CENTERLINE OF METER BOX SHALL BE OFFSET 2-1/4" FROM CENTERLINE OF ANGLE METER STOP.
3. SEE STANDARD DRAWINGS CL-4-08 AND CL-5-08 FOR ADDITIONAL LOCATION AND CLEARANCE REQUIREMENTS.
4. ANY SEALS OR LOCKS PLACED ON A CLOSED ANGLE METER STOP OR CURB STOP SHALL NOT BE REMOVED EXCEPT BY ACWD.
5. METER BOX SHALL BE INSTALLED ON COMPACTED MATERIAL.

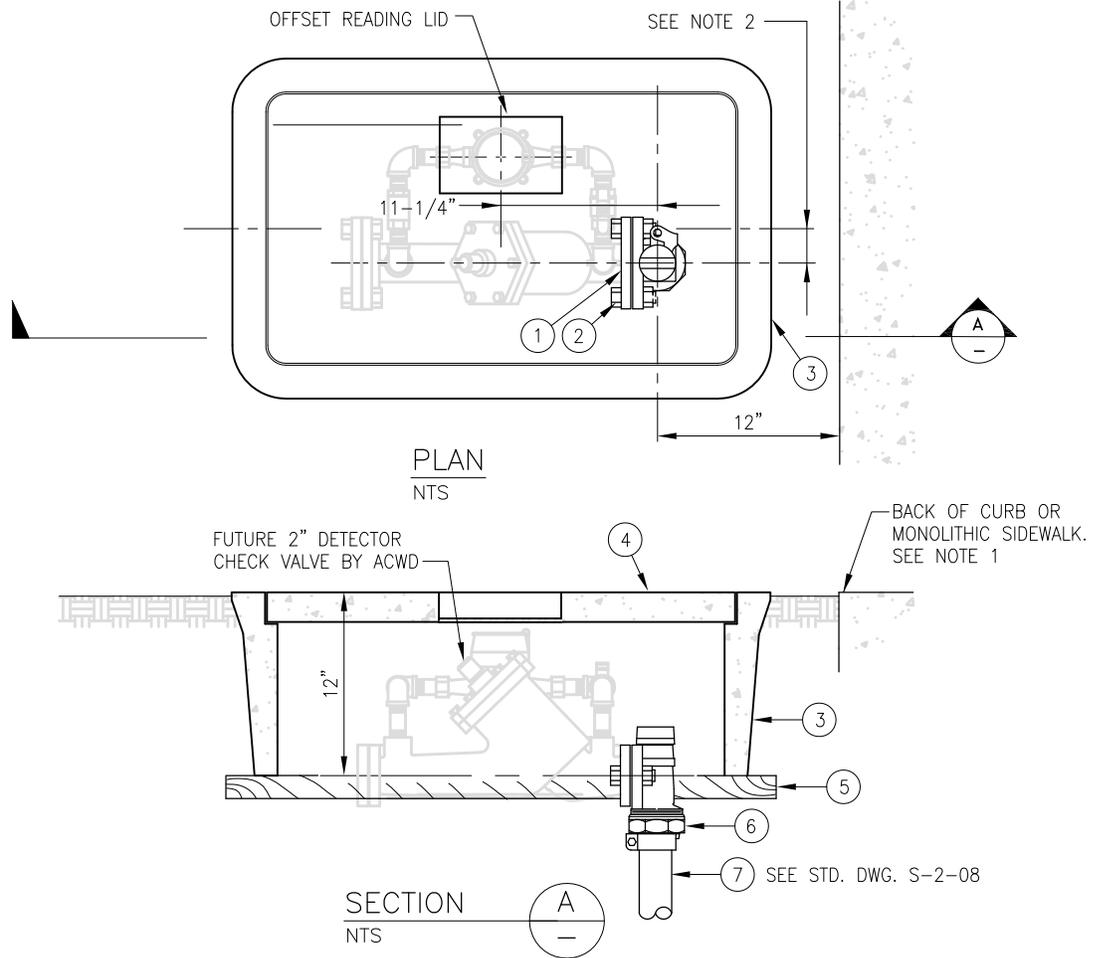

ALAMEDA COUNTY WATER DISTRICT  
43885 SOUTH GRIMMER BOULEVARD  
P.O. BOX 5110  
FREMONT, CA 94537-5110  
(510) 668-4200

STANDARD DRAWING

2" SERVICE LINE AND DETECTOR CHECK VALVE

APPROVED *Albert Chavez* 12/15/2008  
ENGINEERING MANAGER DATE

				DESIGNED	ACWD	DATE:	DEC. 2008
				DRAWN	DBB	SCALE:	NONE
0	12-08	NEW STD. DWG.	RMF LJA	CHECKED	LJA	DWG. NO.	
NO.	DATE	REVISION	BY APP.	DIV. MGR.	EHS		
						<b>S-10-08</b>	<b>0</b>