


ITEM	DESCRIPTION
1	METAL TAG. SEE NOTE 1
2	ADDRESS MARKING. SEE NOTE 2
3	SELF-LOCKING WIRE OR CABLE TIE FASTENED AROUND ANGLE STOP AT CONNECTION TO SERVICE LINE


NOTES:

- METAL TAG SHALL BE BRASS OR STAINLESS STEEL PLATE WITH MINIMUM 0.015" THICKNESS PRESTAMPED WITH 1/4"-HIGH NUMBERS OF THE ADDRESS OF THE UNIT WHICH IS SERVED BY THE METER. SEE DETAIL 1. METAL TAG SHALL HAVE A HOLE FOR SELF-LOCKING WIRE OR CABLE SEAL TIE.
- LOWER RIGHT CORNER OF METER BOX RIM POLYETHYLENE FACE SHALL BE SANDED DOWN SMOOTH AND STAMPED WITH 1/4"-HIGH NUMBERS OF THE ADDRESS OF THE UNIT WHICH IS SERVED BY THE METER. SEE DETAIL 2.
- ADDRESS LABELS AND MARKINGS ARE REQUIRED FOR ALL METERS AND DETECTOR CHECK VALVES THROUGH 2" (EXCEPT IRRIGATION METERS) THAT ARE LOCATED SUCH THAT THE BUILDING OR UNIT THE METER OR DETECTOR CHECK SERVES IS NOT READILY APPARENT, WHEN SERVICES ARE BANKED, AND AS OTHERWISE DIRECTED BY THE DISTRICT.
- SEE STANDARD DRAWINGS S-1-08 THROUGH S-8-08 FOR METER AND METER BOX INSTALLATION DETAILS. SEE STANDARD DRAWING S-10-08 FOR DETECTOR CHECK AND METER BOX INSTALLATION DETAILS.
- SEE STANDARD DRAWINGS CL-4-08 AND CL-5-08 FOR ADDITIONAL METER AND SERVICE LINE LOCATION AND CLEARANCE REQUIREMENTS.
- ALL ITEMS LISTED TO BE INSTALLED BY WATER MAIN CONTRACTOR.
- ANY SEALS OR LOCKS PLACED ON A CLOSED ANGLE METER STOP OR CURB STOP SHALL NOT BE REMOVED EXCEPT BY ACWD.

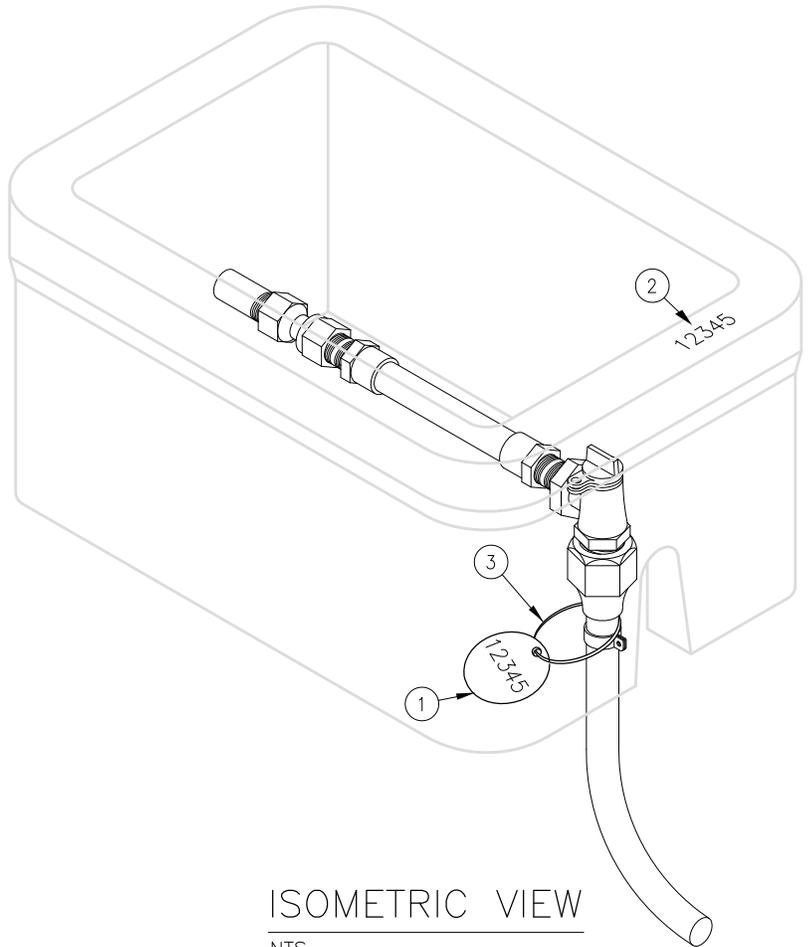


ISOMETRIC VIEW

NTS

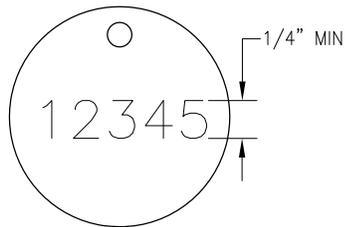

METAL TAG 1  
NTS

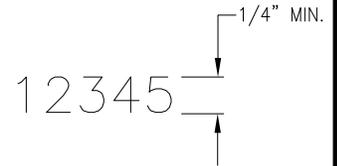

ADDRESS MARKING 2  
NTS



ALAMEDA COUNTY WATER DISTRICT  
43885 SOUTH GRIMMER BOULEVARD  
P.O. BOX 5110  
FREMONT, CA 94537-5110  
(510) 668-4200

STANDARD DRAWING

ADDRESS LABELS AND MARKINGS  
FOR 1" THROUGH 2" SERVICE LINES

APPROVED *Albert Chavez* 12/15/2008  
ENGINEERING MANAGER DATE

					DESIGNED	ACWD	DATE:	DEC. 2008	
					DRAWN	RMF	SCALE:	NONE	
0	12-08	NEW STD. DWG.	RMF	LJA	CHECKED	LJA	DWG. NO.		REV.
NO.	DATE	REVISION	BY	APP.	DIV. MGR.	EHS		<b>S-11-08</b>	<b>0</b>